

SPECIFICATION FOR CHARGING STATION CONTROL

Glossary

Charging point

A charging point is an interface that communicates with the Energy Manager as the central energy management system. Only one electric vehicle can be charged at a charging point at any one time.

Charging station (e.g. wall box, charging column or quick charging station)

A charging station can feature several charging points to allow for charging in parallel.



Common charging connectors (“charging sockets”)

Type 2 connector


This three-phase connector is the most widespread in Europe and has been set as the standard. Charging power up to 22 kW (400 V, 32 A) is common in private settings, while public charging stations offer charging power up to 43 kW (400 V, 63 A).



Type 2
connector

Combo connector (Combined Charging System, CCS)

The CCS connector (European standard EN 62196) adds a quick charging feature to the type 2 connector through two additional power contacts and supports AC and DC charging (alternating and direct current charging) up to 170 kW.



CCS combo
connector

CHAdemo connector

This quick charging system allows charging processes of up to 100 kW.



CHAdemo
charging
connector

Individual charging points vs. master/slave control

There are several options for controlling charging points, depending on the charging technology used and the function required. All options require an interface that is compatible with the *Energy Manager* to ensure local load management on the part of the charging technology used. Provided the charging technology has its own energy meters, these can usually be read via the local interface. Otherwise, additional energy meters need to be used to visualise individual charging powers.

Individual control: provided each charging point has an interface for local load management, the Energy Manager allows individual control of up to 25 charging points, each with its own charge set point. In this case, distribution of the available power to the charging points is determined by the Energy Manager and is configured in the Energy Manager's configuration interface.

Master/slave system: provided the charging technology used features a master/slave system, a charge set point can be assigned to the master by the Energy Manager. The available power is then distributed via the master's controls, with distribution being configured in the charging technology's interface.

These two options can also be combined. This allows individual charging points to be controlled straight from the Energy Manager, while at the same time distributing some of the available power to a group of other charging points through a master/slave system. The total number of charge set points involved may not exceed 25.

What is a charge set point?

A charge set point is a signal input that is used to communicate a power limit to the charging technology. A charge set point can be conveyed to a single charging point or as an overall set point to the master/slave controls for a group of charging points.

Product description


Where a user has only a limited grid connection, they can dynamically control the output of the charging infrastructure. The minimum requirement for this is a Energy Manager and power measurement. The power measurement gauges the power at the limited grid connection. Energy Manager establishes the power available to the charging infrastructure, while allowing for other consumers and generators. It conveys the available power to individual charging points and/or the master/slave controls for charging point groups in the form of set points. This can control up to 25 charge set points.

Where power needs to be distributed intelligently in the network rather than simply being limited, then each charging station needs to have a master/slave management or its own charging management.

What is the difference between the Basic and Pro versions?

The **Basic version** of the Energy Manager includes charge controls for one charging point. A master/slave arrangement of the charging technology also allows several charging points to be controlled via one charge set point, but only via general power controls and not separately from one another.

The **Pro version** has all the features of the Pro package, while also permitting dynamic load management of up to 25 charging points with one Energy Manager. It also offers the option of prioritising different members of the charging system, for example hard or soft prioritisation according to charging point number, or first come – first serve and last come – first serve (see below).

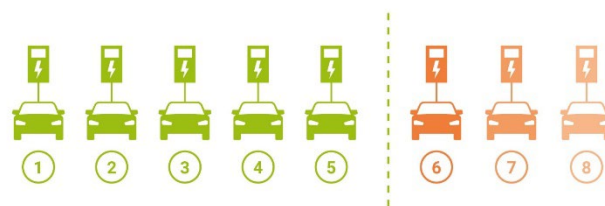


Where there are six or more charge (set) points being controlled, an additional EUR 21/charge (set) point is payable per year (see diagram above). More than 25 charge set points can be operated with the use of additional Energy Managers.

Where is it worthwhile to have a charge set point in the Basic version?

Having high charging power makes sense for charging electric vehicles as quickly as possible. The cost of extending the grid connection to supply the higher currents required for this is, however, very high. Increasing the connected load normally costs grid operators sums into the mid-to-high five figures. Higher demand rates also need to be added to this.

Where outputs of more than 11 kW (from the second charging station) need to be obtained at the grid connection, the grid operator also requires there to be an energy management system in place before the corresponding system can be approved. They do this to avoid supply disruptions that could be triggered by fuses being tripped.

An effective energy management system ensures that, even when only low currents are available, several electric vehicles can easily be charged at maximum current without the grid connection fuse being triggered or the threshold being passed.

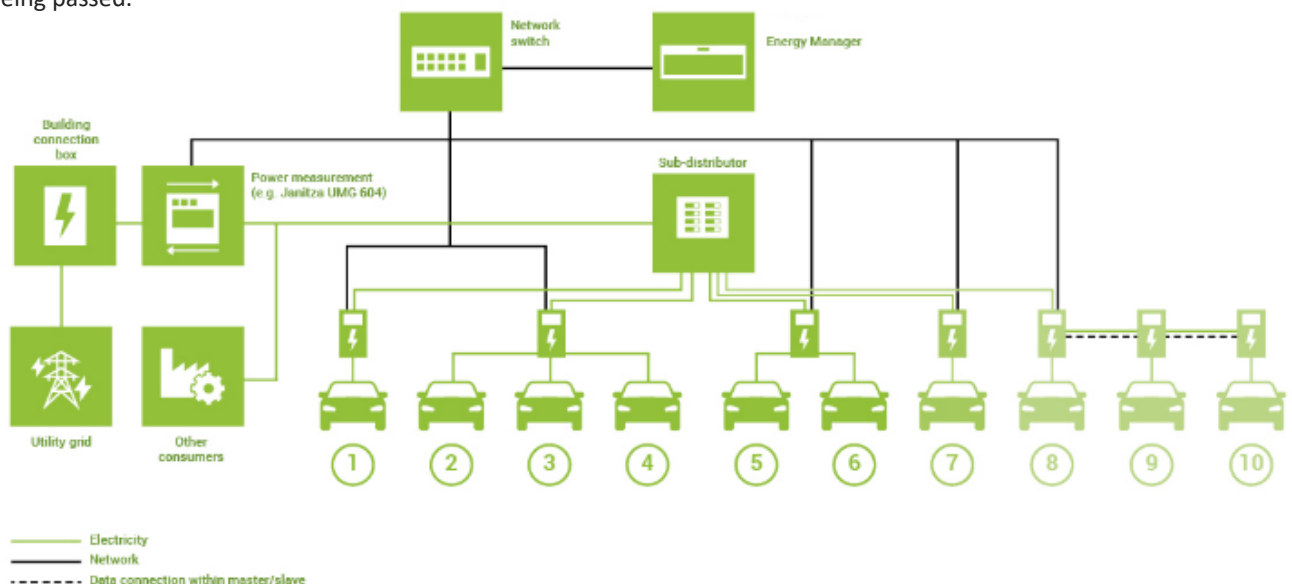

Prioritisation


Types of prioritisation

Hard prioritisation

With hard prioritisation, the top-priority charging point gets as much power as it needs.

Any remaining surplus is redistributed in the order of prioritisation, with the next charging point down getting as much power as is still available.

Example of application: e.g. long-distance vehicle plus city car

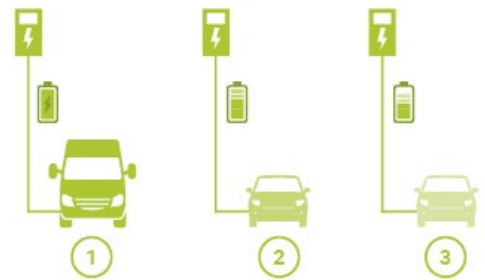

Medium prioritisation

The top-priority charging point is given the minimum charging power (6 A). Any remaining surplus is redistributed in the order of prioritisation, with the next charging point down initially getting only the minimum charging power. If anything is left over, the top-priority charging point gets all the surplus as additional charging power, before the next point is supplied.



Soft prioritisation

With soft prioritisation, the top-priority charging point is only given the minimum charging power (6 A).

Any remaining surplus is redistributed in the order of prioritisation, with the next charging point down again initially getting only the minimum charging power. Any further surplus is distributed evenly across all other charging points.

Sample application: e.g. shopping centres or multi-storey car parks



Order of prioritisation

All three types of prioritisation (hard, medium, soft) can be applied in different orders:

- First come – first serve (e.g. apartment buildings, car sharing)
- Last come – first serve (e.g. for customer parking)
- According to charging point number (e.g. director's parking space)